



B Brugsvandsveksler  
 2 Kontraventil  
 7 Termisk ventil

11 Brugsvandscirk.pumpe  
 18 Termometer

Unit no.:  
 99181900  
 Unit no.:  
 99182000  
 Unit no.:  
 Unit no.:

OBS.:  
 Føleren fra den mindste ventil  
 skal monteres tættest på veksleren.

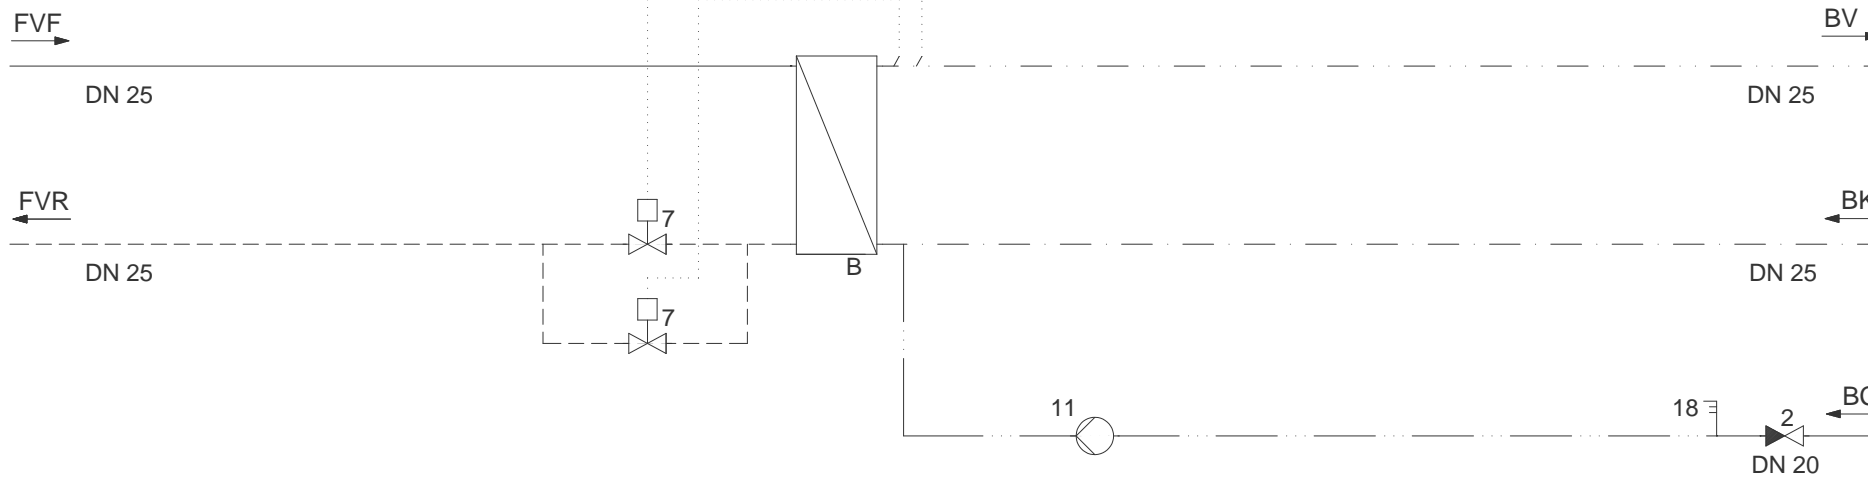

 <b>Gemina • Termix</b> Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.:	Date:	Sign:
	JOE 21.06.05	16.03.05	SJJ
Drwg. no.:			
99181900			
Title:			
Termix BV-unit type 4 & 5 T-CP (20T)			
Principdiagram Fjernvarmestation	Rev:	Date:	Sign.: