



- B Brugsvandsveksler
- F Automatik
- 1 Afspærringsventil
- 2 Kontraventil
- 7 Termisk ventil
- 10 Varmecirkulationspumpe
- 11 Brugsvandscirkul-pumpe
- 16 Udeføler
- 18 Termometer
- 19 Påspændingsføler
- 23 Kugleventil
- 24 Leveres løst med
- 27 Motor
- 29 Motorventil
- 31 Differenstrykregulator

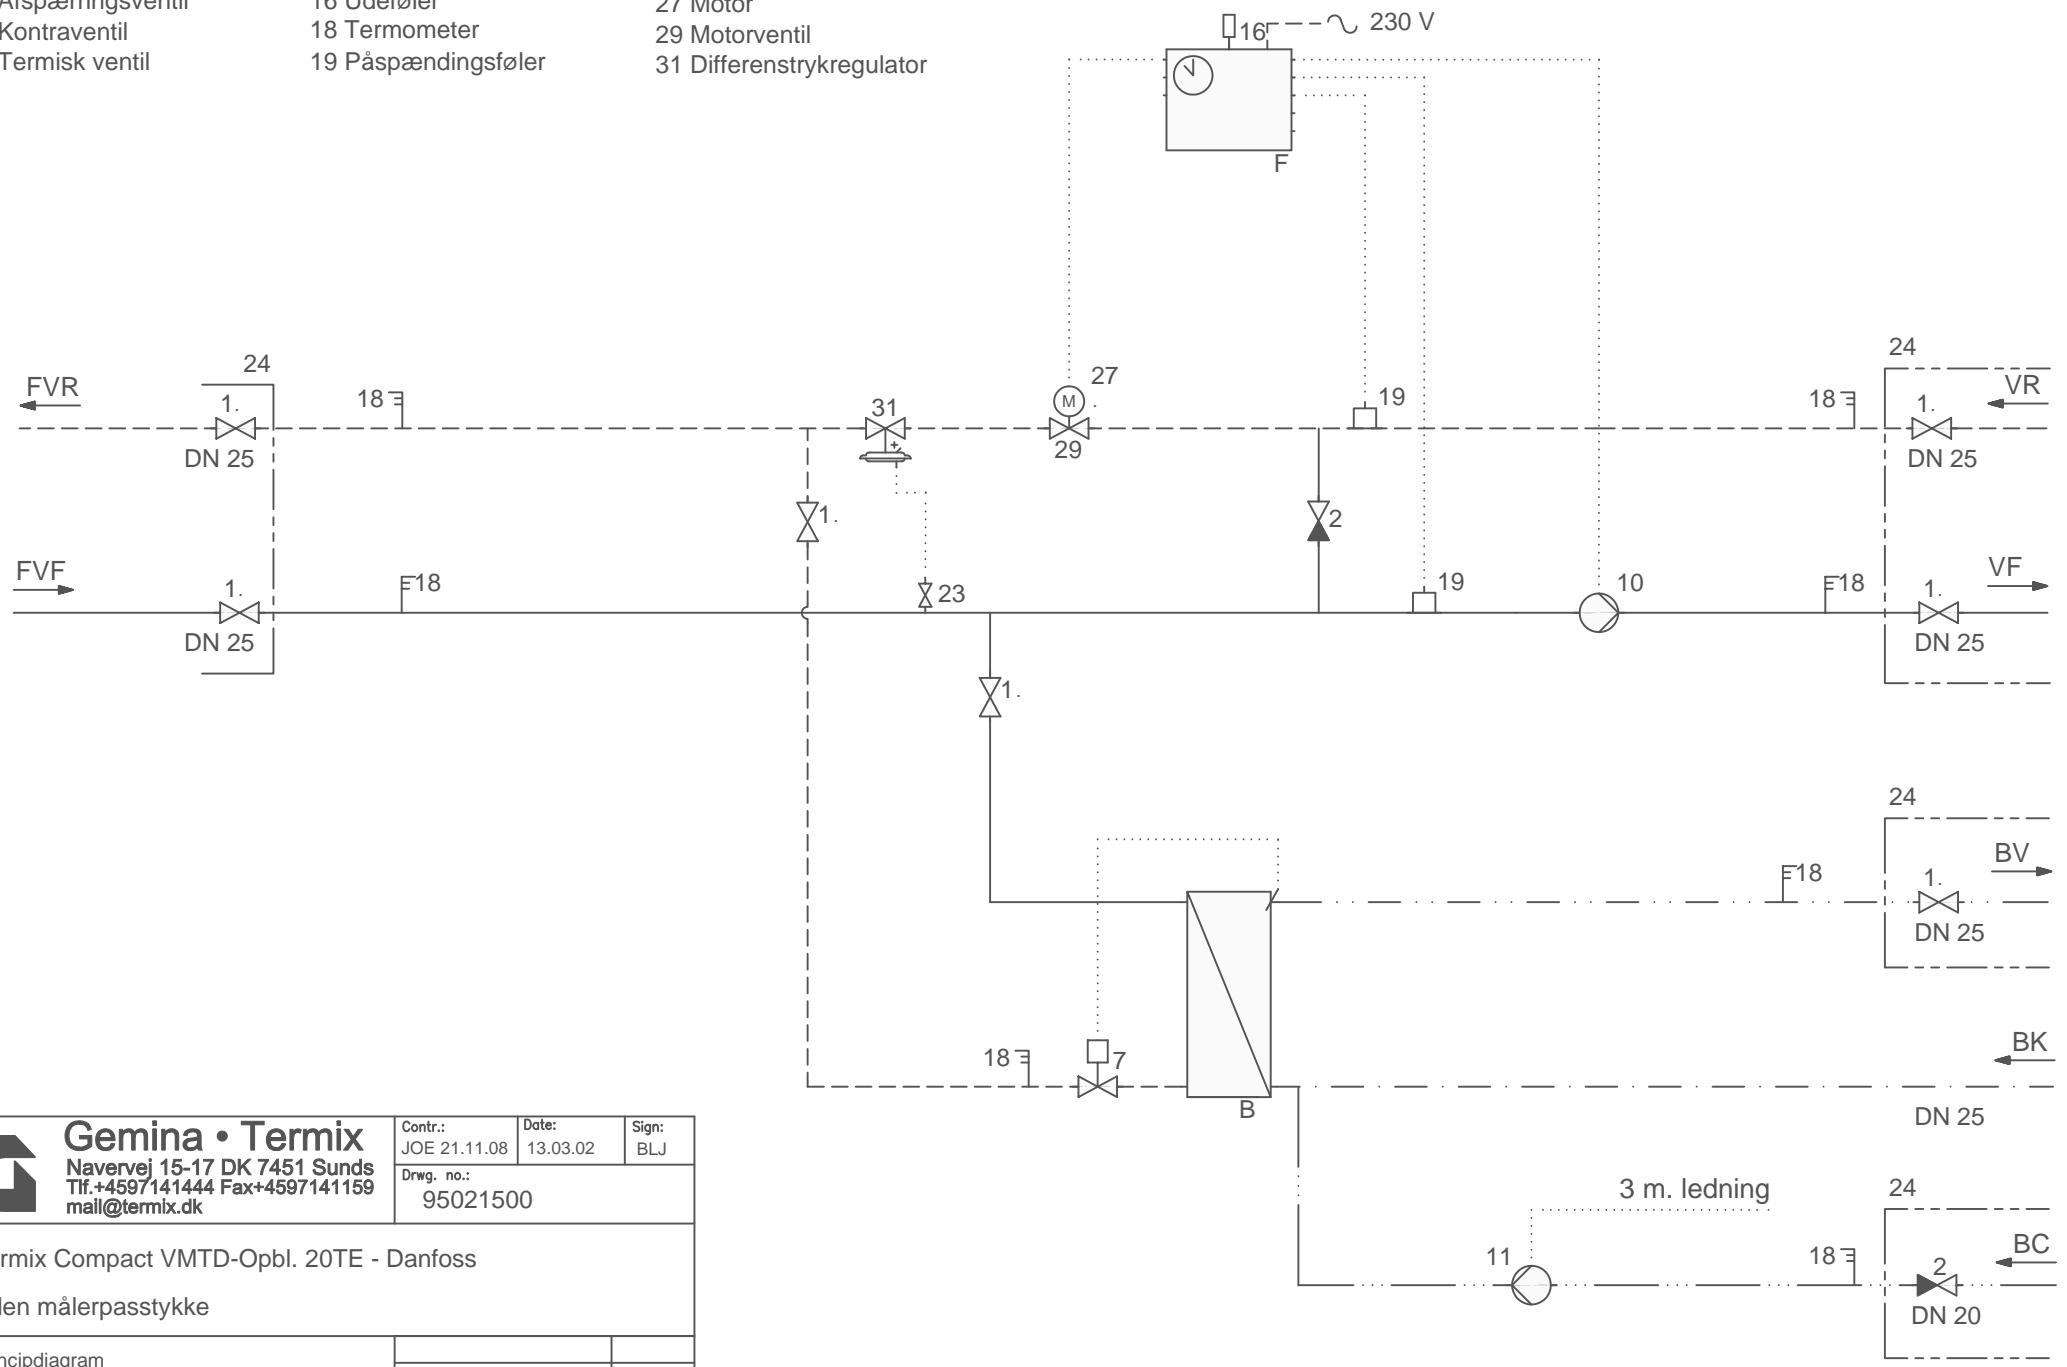

 Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.: JOE 21.11.08	Date: 13.03.02	Sign: BLJ
	Drwg. no.: 95021500		
Title: Termix Compact VMTD-Opbl. 20TE - Danfoss			
Uden målerpasstykke			
Principdiagram			
Fjernvarmestation			
Rev:	Date:	Sign.:	